


# EN12101-2:2003

## UKCA Certified NSHEV Solutions

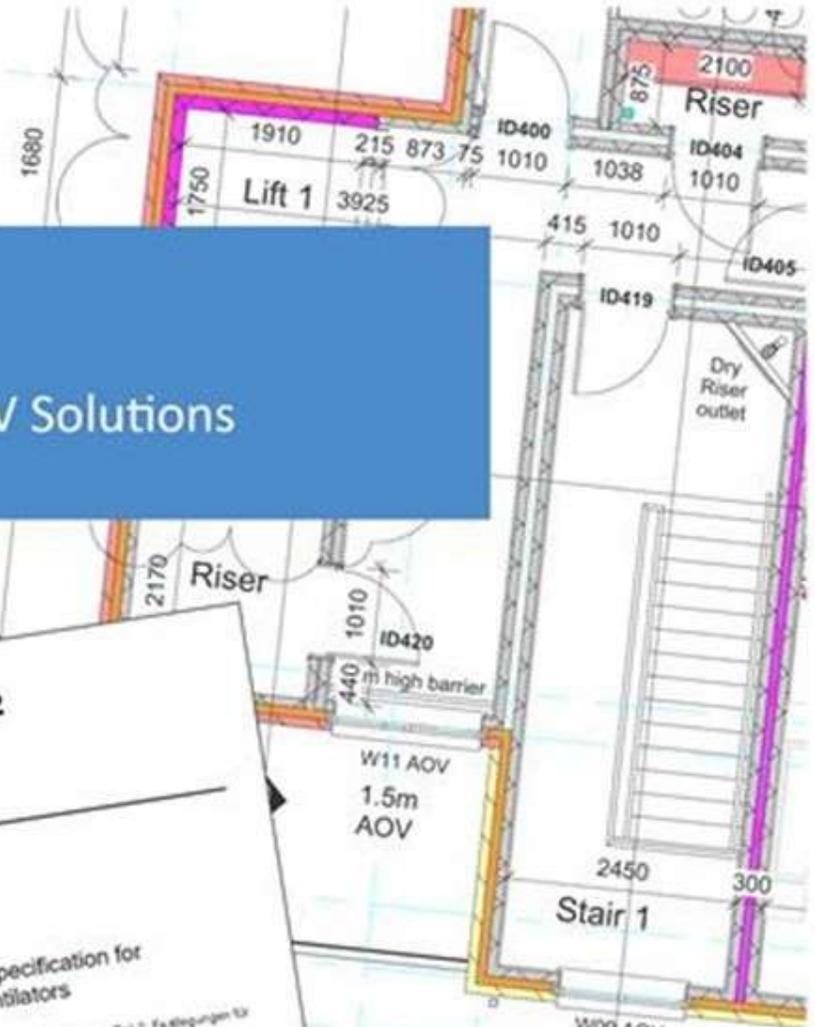

**EN 12101-2**  
June 2003

EUROPEAN STANDARD  
NORME EUROPÉENNE  
EUROPÄISCHE NORM

ICS 13.220.20, 23.120

English version

**Smoke and heat control systems - Part 2: Specification for natural smoke and heat exhaust ventilators**

Rauch- und Wärmehaftung - Teil 2: Festlegungen für natürliche Rauch- und Wärmeabzuggeräte

Systèmes pour le contrôle des fumées et de la chaleur - Partie 2: Spécifications pour les dispositifs d'évacuation de fumées et de chaleur

This European Standard was approved by CEN on 3 April 2003.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving the European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Slovakia, Slovenia, Spain, Sweden, Switzerland, United Kingdom.

Official Journal of the European Union

44.2011

**REGULATION (EU) No 305/2011 OF THE EUROPEAN PARLIAMENT AND OF THE COUNCIL**  
of 9 March 2011  
laying down harmonised conditions for the marketing of construction products and repealing Council Directive 89/106/EEC  
(Text with EEA relevance)

THE EUROPEAN PARLIAMENT AND THE COUNCIL OF THE EUROPEAN UNION

Member States have introduced provisions, but requirements, relating not only to safety of buildings and other construction works but also to health, energy efficiency, protection of the environment, and other important aspects.



# SCHÜCO

# 1

## Schuco AWS 70Hi SE Controls NSHEV

It is a mandatory requirement under the Construction Products Regulations (Regulation (EU) No 305/2011) for Natural Smoke and Heat Exhaust Ventilators (NSHEVs) to be UKCA certified as conforming to the Harmonised Standard EN12101-2:2003.

Schuco and SE Controls have collaborated on an extensive test and certification program with IFCC, a UK Notified Body (Notified Body Nr. 1720) to meet this requirement and ensure a seamless façade installation and performance can be provided.

The following Schuco frame systems can be certified under SE Controls' Tested Solutions program.

Frame System	Applications	Refer to
Schuco AWS 70Hi	Side Hung, Bottom Hung, Top Hung Open Out	Section 3.1

## 2 Manufacturing

Prior to manufacturing an NSHEV it is important to seek guidance from SE Controls to ensure the NSHEV is manufactured under an annually audited EN12101-2 System 1 Factory Production Control process.

It is mandatory this is in place before manufacturing. Please register your interest to [Façade.technical@secontrols.com](mailto:Façade.technical@secontrols.com)

If an NSHEV is not manufactured under an EN12101-2 System 1 Factory Production Control process the product will not be certifiable by SE Controls.



### Contact the SE Controls Façade Support Team

SE Controls  
Lancaster House, Fradley, Lichfield  
WS13 8RZ  
Tel +44 1543 443060

Creating a **Healthier & Safer** Environment

### 3 Certification

3.1 Essential Characteristics declared on the SE Controls NSHEV Declaration of Performance (DoP) as defined by EN12101-2:2003 Annex ZA.1.

<b>CCP 1720-CPR-0169</b>		
<b>Essential Characteristics</b>	<b>Clauses in This European Standard</b>	<b>Mandated Level(s) or Class(es)</b>
<b>Nominal Activation Conditions/sensitivity</b>	4.1 4.2	24V dc.
<b>Response relay (Time relay)</b>	7.1.2	<60s
<b>Operational Reliability</b>	7.1 7.4	Re 1000 NPD Single Chain WL1500 Twin Chain
<b>Effectiveness of smoke/hot gas extraction</b>	6.	Pass
<b>Aerodynamic free area</b>	6.	Pass
<b>Performance parameters under fire conditions</b>	7.5	30
<b>Resistance to fire – Mechanical stability</b>	7.5	B300
<b>Ability to open under environmental conditions</b>	7.2 7.3	T(00) SL(0)
<b>Fire reaction</b>	7.5.2.1	NPD

“PASS”; Each NSHEV will have a specific aerodynamic free area based upon its dimensions, opening angle and applicable coefficient of discharge (Cv) of between 0.31 and 0.62.

### 3.2 Factory Production Control

The vent is manufactured, the actuator installed and the NSHEV completed under SE Controls' System 1 Factory Production Control (FPC) process, audited by the Approved Body, IFCC in accordance with the requirements of the Construction Products Regulation (EU) No 305/2011 and EN12101-2:2003 product standard.

The Certificate of Constancy of Performance (CoCoP) issued by IFCC and Declaration of Performance (DoP) issued by SE Controls confirms the audited system 1 FPC process is in place.

The NSHEV is certified and placed upon the market by SE Controls in the capacity of the manufacturer.



Contact the SE Controls Facade Support Team

SE Controls  
Lancaster House, Fradley, Lichfield  
WS13 8RZ  
Tel +44 1543 443060

Creating a **Healthier & Safer** Environment

## 4 Schuco AWS 70Hi SE Controls NSHEV Certifiable Parameters

### 4.1

Orientation	Maximum Outer Frame Width	Maximum Outer Frame Height	Minimum Outer Frame Width	Minimum Outer Frame Height	Maximum Sash Weight	Hinges	Actuator
Side Hung	1000mm	1500mm	500mm	685mm	60Kg	Butt Hinges	SECO Ni 24 40 Actuator Single
Side Hung	1000mm Or 1200mm	2200mm Or 1900mm	500mm	1345mm	85Kg	Butt Hinges	SECO Ni 24 40 Actuator Twin
Bottom Hung	1500mm	1200mm	685mm	500mm	60Kg	Butt Hinges	SECO Ni 24 40 Actuator Single
Bottom Hung	1900mm	1200mm	1345mm	500mm	75Kg	Butt Hinges	SECO Ni 24 40 Actuator Twin
Top Hung	1500mm	1200mm	685mm	500mm	60Kg	Butt Hinges	SECO Ni 24 40 Actuator Single
Top Hung	1900mm	1200mm	1345mm	500mm	75Kg	Butt Hinges	SECO Ni 24 40 Actuator Twin

Any make up of double-glazed unit or triple-glazed unit can be assessed providing the weight of the vent remains within maximum weight limitation stated above.

Infill panels must have minimum classification certificates for combustibility and achieve Class A2,S1-d0 under EN13501-1. The panels must also be compatible with the System Company profiles (glazing clips etc.). Unless specifically tested as a combination, Reaction to Fire will be declared as NPD on the Declaration of Performance. Please contact [façade.technical@secontrols.com](mailto:façade.technical@secontrols.com) for more information.



Contact the SE Controls Facade Support Team

SE Controls  
Lancaster House, Fradley, Lichfield  
WS13 8RZ  
Tel +44 1543 443060

Creating a **Healthier** &  
**Safer** Environment

## 4.2 Sash/Frame Combinations

Frame Reference	Sash Reference	Prep Detail Reference (Single Chain)	Prep Detail Reference (Twin Chain)
197 370	480 800	SEF_1875	SEF_1882
197 440	480 800	SEF_1876	SEF_1883
197 510	480 800	SEF_1877	SEF_1884
197 410	480 800	SEF_1878	SEF_1885
197 500	480 800	SEF_1879	SEF_1886
197 360	480 810	SEF_2547	SEF_2548
197 370	480 810	SEF_1880	SEF_1887
197 380	480 810	SEF_2524	SEF_2525
494 310	480 810	SEF_2064	SEF_2067
197 530	480 800	SEF_2065	SEF_2068
197 440	480 810	SEF_2066	SEF_2069
197 530	480 810	SEF_2169	SEF_2170

**The information provided in this document must be used in conjunction with the Schuco AWS 70Hi AOV Technical Manual.**



**Contact the SE Controls Facade Support Team**

SE Controls  
Lancaster House, Fradley, Lichfield  
WS13 8RZ  
Tel +44 1543 443060

Creating a **Healthier & Safer** Environment

## 5 System Design and Installation Considerations

### 5.1 Free Area

The free area essential characteristic of an NSHEV is declared on the Declaration of Performance as “Aerodynamic Free Area”. Often building codes do not specify aerodynamic free areas, but instead require a Geometric Free Area (e.g., 1.5m<sup>2</sup>) and the two methods should not be confused.

A Geometric Free Area will be larger than the Aerodynamic Free Area for the same NSHEV, but they are not directly comparable.

Refer to the applicable design standard BS 9991:2024 (Section 20.1. Table 3 - Summary of Smoke Control Provisions)

**Top Of stair Vent for a building below 11 meters tall: 0.7m<sup>2</sup> (Aerodynamic Free Area)**

**Top Of stair Vent for a building above 11 meters tall: 0.7m<sup>2</sup> (Aerodynamic Free Area)**

**Lobby / Corridor vent for a building above 11 meters tall: 0.9m<sup>2</sup> (Aerodynamic Free Area)**

### 5.2 Controls

NSHEVs must be operated by a compatible EN12101-10 compliant control system; SE Controls recommends its OS series of control systems.

### 5.3 Safety: Entrapment Protection

Consideration should be given to the installation of suitable measures to mitigate the risks of entrapment.

NSHEVs should be closed/ reset via a local Manual Control Point (MCP) with a ‘biased off principle’\*, or alternative safety measures/ operational procedures should be considered.

\*Smoke Control Association: Guidance on Smoke Control to Common Escape Routes in Apartment Buildings (Flats and Maisonettes) Revision 3.1: July 2020

For advice on further safety considerations contact SE Controls.

### 5.4 Safety: Fall Restraint

Consideration should be given to the installation of suitable measures to mitigate the risks of falling through an NSHEV.

For advice on additional window restraint options contact SE Controls.

### 5.5 Installation & Maintenance

A smoke ventilation system should be designed, installed and maintained by a suitably competent and trained smoke ventilation specialist.

## 6 Support

Contact the SE Controls Technical Façade Team – [Façade.technical@secontrols.com](mailto:Façade.technical@secontrols.com)

SE Controls, Lancaster House, Wellington Crescent, Fradley, Lichfield, Staffs WS13 8RZ

Tel. +44 1543 443060 Website: [www.secontrols.com](http://www.secontrols.com)



Contact the SE Controls Façade Support Team

SE Controls  
Lancaster House, Fradley, Lichfield  
WS13 8RZ  
Tel +44 1543 443060

Creating a **Healthier & Safer** Environment