

## EN12101-2:2003 Tested Solutions

# Manufacturers Guide

### Architectural & Metal Systems (AMS) TS66 SE Controls NSHEV

It is a mandatory requirement under the Construction Products Regulations (*Regulation (EU) No 305/2011*) for Natural Smoke and Heat Exhaust Ventilators (NSHEVs) to be CE certified as conforming to the Harmonised Standard EN12101-2:2003.


AMS and SE Controls have collaborated on an extensive test and certification program with Applus+, a CE Approved Body (Approved Body Nr. 0370), to meet this requirement and ensure a seamless façade installation and performance can be provided.

### Manufacturing

Prior to manufacturing an NSHEV it is important to seek guidance from SE Controls to ensure the NSHEV is manufactured under an annually audited EN12101-2 System 1 Factory Production Control process.

It is mandatory this is in place before manufacturing. Please register your interest at [info@secontrols.com](mailto:info@secontrols.com)

If an NSHEV is not manufactured under an EN12101-2 System 1 Factory Production Control process, the product will not be certifiable by SE Controls.

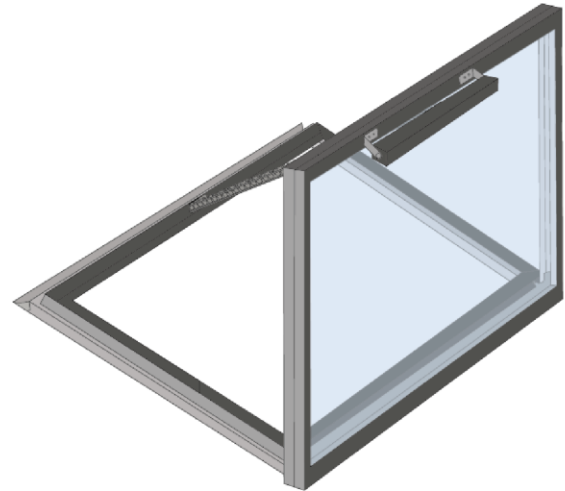

### Tested Solution



The following AMS frame systems can be **CE certified** under SE Controls' Tested Solutions program:

#### Frame System

AMS TS66 Window

AMS T66 Door

#### Applications (Open Out)

Side Hung, Top Hung, Bottom Hung

Side Hung

# 1. Certification

## 1.1 Essential Characteristics

Essential Characteristics declared on the SE Controls NSHEV Declaration of Performance (DoP) as defined by EN12101-2:2003 Annex ZA.1.

CCP 0370 - CPR-6858		
Essential Characteristics	Clauses in This European Standard	Mandated Level(s) or Class(es)
Nominal Activation Conditions/sensitivity	4.1 4.2	24V dc.
Response relay (Time relay)	7.1.2	<60s
Operational Reliability	7.1 7.4	Re 1000 +10000 Dual Purpose WL1500
Effectiveness of smoke/hot gas extraction	6.	Pass
Aerodynamic free area	6.	Pass
Performance parameters under fire conditions	7.5	30
Resistance to fire - Mechanical stability	7.5	B300
Ability to open under environmental conditions	7.2 7.3	T(00) SL(0)
Fire reaction	7.5.2.1	E

“PASS”; Each NSHEV will have a specific aerodynamic free area based upon its dimensions, opening angle and applicable coefficient of discharge (Cv) of between 0.31 and 0.62.

## 1.2 Factory Production Control

The vent is manufactured, the actuator installed and the NSHEV completed under SE Controls' System 1 Factory Production Control (FPC) process, audited by the Approved Body, Applus+ in accordance with the requirements of the Construction Products Regulation (EU) No 305/2011 and EN12101-2:2003 product standard.

The Certificate of Constancy of Performance (CoCoP) issued by Applus+ and Declaration of Performance (DoP) issued by SE Controls confirm the audited system 1 FPC process is in place.

The NSHEV is certified and placed upon the market by SE Controls in the capacity of the manufacturer.

## 2. AMS TS66 SE Controls NSHEV Certifiable Parameters

### 2.1 TS66 Window

Orientation	Frame Profile	Sash Profile	Max. Outer Frame Width	Max. Outer Frame Height	Min. Outer Frame Width	Min. Outer Frame Height	Max Outer Frame Weight	Glass Spec. (mm)	Hinges	Actuator
<b>Side Hung</b>	TS6202 TS6209 TS6011	TS6923 TS6913	1000mm	1500mm	500mm	685mm	42KG	4/*/4 DGU	Crest Heavy Duty Hinge*	SECO Ni 24 40 Actuator Single / Twin
<b>Top Hung</b>	TS6202 TS6209 TS6011	TS6923 TS6913	1500mm	1200mm	685mm	500mm	42KG	4/*/4 DGU	Crest Heavy Duty Hinge*	SECO Ni 24 40 Actuator Single / Twin
<b>Bottom Hung</b>	TS6202 TS6209 TS6011	TS6923 TS6913	1500mm	1200mm	685mm	400mm	42Kg	4/*/4 DGU	Crest Heavy Duty Hinge*	SECO Ni 24 40 Actuator Single / Twin

\*Please refer to AMS TS66 Smoke Vent System Specification Manual for correct number of hinges.

### 2.2 TS66 Door

Orientation	Frame Profile	Sash Profile	Max. Outer Frame Width	Max. Outer Frame Height	Min. Outer Frame Width	Min. Outer Frame Height	Max Outer Frame Weight	Glass Spec. (mm)	Hinges	Actuator
<b>Side Hung</b>	<b>TS6011</b> <b>TS6211</b>	<b>TS6021</b>	1238mm	1500mm	500mm	685mm	100KG	8/*/8 DGU Or 4/*/4/*/4 TGU	Crest Heavy Duty Hinge*	SECO Ni 24 40 Actuator Single / Twin
<b>Side Hung</b>	<b>TS6011</b> <b>TS6211</b>	<b>TS6021</b>	1238mm	2450mm	500mm	1350mm	100KG	8/*/8 DGU Or 4/*/4/*/4 TGU	Crest Heavy Duty Hinge*	SECO Ni 24 40 Actuator Twin

\*Please refer to AMS TS66 Smoke Vent System Specification Manual for correct number of hinges.

## 2.3 Sash/Frame Combinations

Frame Reference	Sash Reference	Prep Detail Reference (Single Chain)	Prep Detail Reference (Twin Chain)
TS6 202	TS6 923 (913)	SEF_2721	SEF_2776
TS6 011	TS6 923 (913)	SEF_2769	SEF_2777
TS6 209	TS6 923 (913)	SEF_2770	SEF_2778
TS6 302	TS6 923 (913)	SEF_2774	SEF_2782
TS6 315	TS6 923 (913)	SEF_2853	SEF_2856
TS6 316	TS6 923 (913)	SEF_2060	SEF_2062
TS6 321	TS6 923 (913)	SEF_2854	SEF_2857
TS6 211	TS6 923 (913)	SEF_2775	SEF_2783
TS6 211	TS6 021	SEF_2785	SEF_2786
TS6 011	TS6 021	SEF_2784	SEF_2722

The information provided in this document must be used in conjunction with the AMS TS66 Technical Manual.

## 3. System Design and Installation Considerations

### 3.1 Free Area

The free area essential characteristic of an NSHEV is declared on the Declaration of Performance as "Aerodynamic Free Area". Often building codes do not specify aerodynamic free areas, but instead require a Geometric Free Area (e.g., 1.5m<sup>2</sup>). The two methods should not be confused.

Refer to the applicable design standard BS 9991:2024 (Section 20.1. Table 3 - Summary of Smoke Control Provisions)

**Top Of stair Vent for a building below 11 meters tall: 0.7m<sup>2</sup> (Aerodynamic Free Area)**

**Top Of stair Vent for a building above 11 meters tall: 0.7m<sup>2</sup> (Aerodynamic Free Area)**

**Lobby / Corridor vent for a building above 11 meters tall: 0.9m<sup>2</sup> (Aerodynamic Free Area)**

### 3.2 Controls

NSHEVs must be operated by a compatible EN12101-10 compliant control system; SE Controls recommends its OS series of control systems.

### 3.3 Safety: Entrapment Protection

Consideration should be given to the installation of suitable measures to mitigate the risks of entrapment.

NSHEVs should be closed/ reset via a local Manual Control Point (MCP) with a 'biased off principle\*', or alternative safety measures/ operational procedures should be considered.

\*Smoke Control Association: Guidance on Smoke Control to Common Escape Routes in Apartment Buildings (Flats and Maisonettes) Revision 3.1:

### 3.4 Safety: Fall Restraint

Consideration should be given to the installation of suitable measures to mitigate the risks of falling through an NSHEV.

For advice on additional window restraint options, contact SE Controls.

### 3.5 Installation & Maintenance

A smoke ventilation system should be designed, installed and maintained by a suitably competent and trained smoke ventilation specialist.

## 4. Support

E:info@secontrols.com

Tel: +44 1543 443060

Website: [www.secontrols.com](http://www.secontrols.com)

